


SPRUHAN ENGINEERING, P.C.
OPERATIONS &
MAINTENANCE PLAN
11 PARSONS ST NEWTON MA.

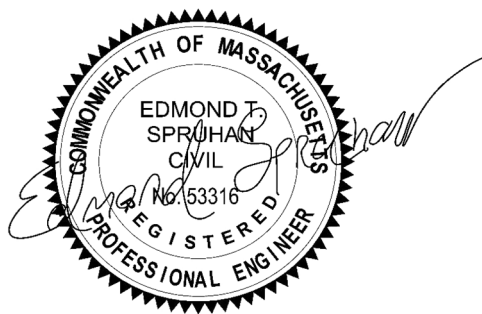

Prepared by: Spruhan Engineering, P.C.
March 12, 2025
November 24, 2025 (R1).

Operations & Maintenance Plan

Introduction

The following Stormwater Operations & Maintenance plan is for **11 Parsons St., Newton, MA**. All erosion and sediment control measures to be used are to be constructed and installed according to the ‘Massachusetts Erosion and Sediment Control Guidelines for Urban and Sub-Urban Areas.’

The plan consists of the following elements:

- Owners’ information
- Operation and maintenance guidance – Pre and Post Construction
- Landscape installation and maintenance guidance
- Proposed inspection log

All erosion and sediment control measures must be installed prior to the commencement of any work. All sediment and erosion control measures shall remain in place until the entire site has been stabilized. The site is deemed stabilized when all landscaped areas have been loamed and seeded with vegetation having had the chance to establish itself. Any proposed paved areas shall have their binder course of pavement installed prior to the removal of these control measures.

The long-term operation and maintenance of a stormwater management system is as critical to its performance as its design and construction. Proper operation and maintenance ensure that the BMP will continue to remove pollutants effectively over the long-term, decreases the risk of re-suspending sediment; and therefore, improves water quality. Without proper maintenance, BMPs are likely to fail and no longer provide the necessary stormwater treatment.

The maintenance of the Drainage System is the exclusive responsibility of the Property Owner. Annual reports (example below) shall be submitted to the City Engineer every January for the prior year.

Name and contact information:

Manager: _____

Address: _____

Contact info: _____

Change on ownership: The owner(s) of the stormwater management systems, with the exception of those associated with two-family dwellings, shall notify the Department of Public Works and Conservation Commission of changes in ownership or assignment of financial responsibility.

This plan is valid in perpetuity and any future property owners are solely responsible for the management of the stormwater system on-site in accordance with this O&M Plan.

Operations & Maintenance

The following operations and maintenance plan has been developed in order to preserve the drainage infrastructure that will be constructed and to ensure the drainage and infiltration system continues to function as designed.

- **Before & During Construction Operation and Maintenance Plan:**

- Significant efforts shall be made to only disturb the minimum amount of area necessary to reduce potential erosion and sediment runoff. The control of dust in disturbed areas shall consist of at the least, wetting of disturbed soil or application of calcium chloride as required to minimize airborne dust.
- A stabilized construction entrance shall be installed to reduce the tracking of material onto the main road, &, if necessary, a wheel wash station put in place.
- Hay wattles shall be installed per the site plan to prevent sediment from being washed off site.
- All drainage structures shall be protected by filter fabric (or approved equal) to prevent sedimentation from entering the drainage system during the construction period.
- Driveway, pavement, and roadway (if required) areas shall be swept to remove sediments prior to introduction into the storm water management system.
- Drainage structures shall be inspected daily and cleaned as necessary of all sedimentation and construction materials during the construction period.
- The contractor is required to contact the engineer of record for drainage system inspection at least 72 hours prior to backfilling in order to receive inspection signoff.

- **Post Construction Operation and Maintenance Plan**

Once the construction is completed, it is the owner's responsibility to maintain the items outlined below to ensure the efficiency and integrity of the drainage systems. The post construction inspections shall take place at a minimum of once during the Spring (March-May), and a minimum of once during the fall (September – November) and after every major storm.

- **Pipes** shall be inspected on a minimum on a semi-annual basis. These inspections shall take place during the spring and fall months of the year. The inspector shall take note of any debris/sediment/clogging and shall document the condition of each structure. Based upon the observed condition, the inspector shall make recommendations if any further action is required.
- **All drainage structures, including manholes trench drains, area drains, cleanouts and catch basins**, shall be inspected four times per year and shall be cleaned of all sand, debris, and sediment four times per year or whenever the depth of deposits is greater than or equal to one half the depth from the bottom of the invert of the lowest pipe in the basin.
- **Roof Gutters** shall be inspected annually and after major rain events. Remove leaves and sediment as necessary to allow rainwater to flow to system.

- **Storm-tech DC-780 Maintenance procedures:**
 - Storm-tech system shall be inspected at a minimum on a semi-annual basis, or after a major storm event.
 - Remove lid and cap from inspection ports which must be brought to finished grade.
 - Using a flashlight and stadia rod, measure the depth of sediment
 - If sediment is above 3” depth, then cleaning is required
 - A licensed professional shall provide cleanout/ flushing services of all sediment and debris via cleanouts and catch basins located per plans.
 - All caps and covers shall be replaced
- **Pump Station.**
 - **Maintenance Requirements:** The pump station will be inspected twice a year to determine if maintenance is required. In general, the inspections will follow the Inspection Checklist found in Attachment A, which include the following:
 - Check for unusual sounds from the pumps.
 - Check pump station control panel and indicator lights.
 - Check for float switch entanglement in the pump station.
 - Check for excessive movement of check valve arm on pump discharge header piping.
 - Check for leakage around pipe connection flanges/joints and valves and pump station walls.
 - Check for excessive sediment, debris, and/or trash within the box culvert and/or sump.
 - Maintenance of the pump station will occur as needed to ensure the pump station is performing properly. Additionally, **annual** maintenance of the pumps will be conducted, including:
 - Remove pumps from pump station and check motor bearings and seals per manufactures recommendations.
 - Check/lube pump and motor per manufactures recommendations.
 - Check bearing temperature.
 - Check shaft coupling.
 - Check shaft sleeve and oil seal.
 - Check stator housing, impeller, and zinc anodes.
 - Clean, wire brush corroded areas, and spot paint, as needed.

Other Activities:

Pavement Sweeping: The paved areas shall be swept every quarter, so four (4) times per year.

Lawn and Landscape Repairs: The lawn and landscaped areas on the site shall be inspected in the spring and fall of each year and the areas shall be restabilized as needed by seeding as lawn or mulching landscaped areas.

An INSPECTION LOG example format is shown below on Table B.1. This must be filled every time an inspection or maintenance activity is performed on any element of the stormwater management on site, included but not limited to:

- Pretreatment devices.

- Vegetation or filter media.
- Control structures.
- Embankments and slopes.
- Inlet and outlet channels and structures.
- Underground drainage.
- Sediment and debris accumulation in storage and forebay areas (including catch basins).
- Any nonstructural practices.
- Any other item that could affect the proper function of the stormwater management system

FINAL IMPORTANT NOTES:

- **PROVISIONS MUST EXIST ALLOWING THE CITY OF NEWTON OR ITS DESIGNEE TO ENTER THE PROPERTY AT REASONABLE TIMES AND IN A REASONABLE MANNER FOR THE PURPOSE OF INSPECTION.**
- **ANNUAL INSPECTION LOGS SHALL BE SUBMITTED TO THE DPW ENGINEERING DIVISION AS REQUIRED TO MAINTAIN CERTIFICATION OF COMPLIANCE UNDER NEWTON'S NPDES MS4 PERMIT.**

PROPERTY OWNER

ATTACHMENT A. LOG SHEET AND TABLES

**OPERATION & MAINTENANCE PLAN
LOG SHEET
11 PARSONS ST., NEWTON, MA**

INSPECTION REPORT:

Inspection Firm: _____

Inspector's Name: _____ Date: _____

Components Inspected: _____

Signed: _____

SYSTEM MAINTENANCE:

Maintenance Firm: _____ Date: _____

Catch Basin Cleaned: Yes ___ No ___ Comments: _____

Manhole & Sumps Cleaned: Yes ___ No ___ Comments: _____

Drain Lines Inspected: Yes ___ No ___ Comments: _____


Stormwater unit System Cleaned: Yes ___ No ___ Comments: _____

Estimate of Material Removed: _____

Other Comments: _____

Signed: _____

ATTACHMENT B. BMP MAP

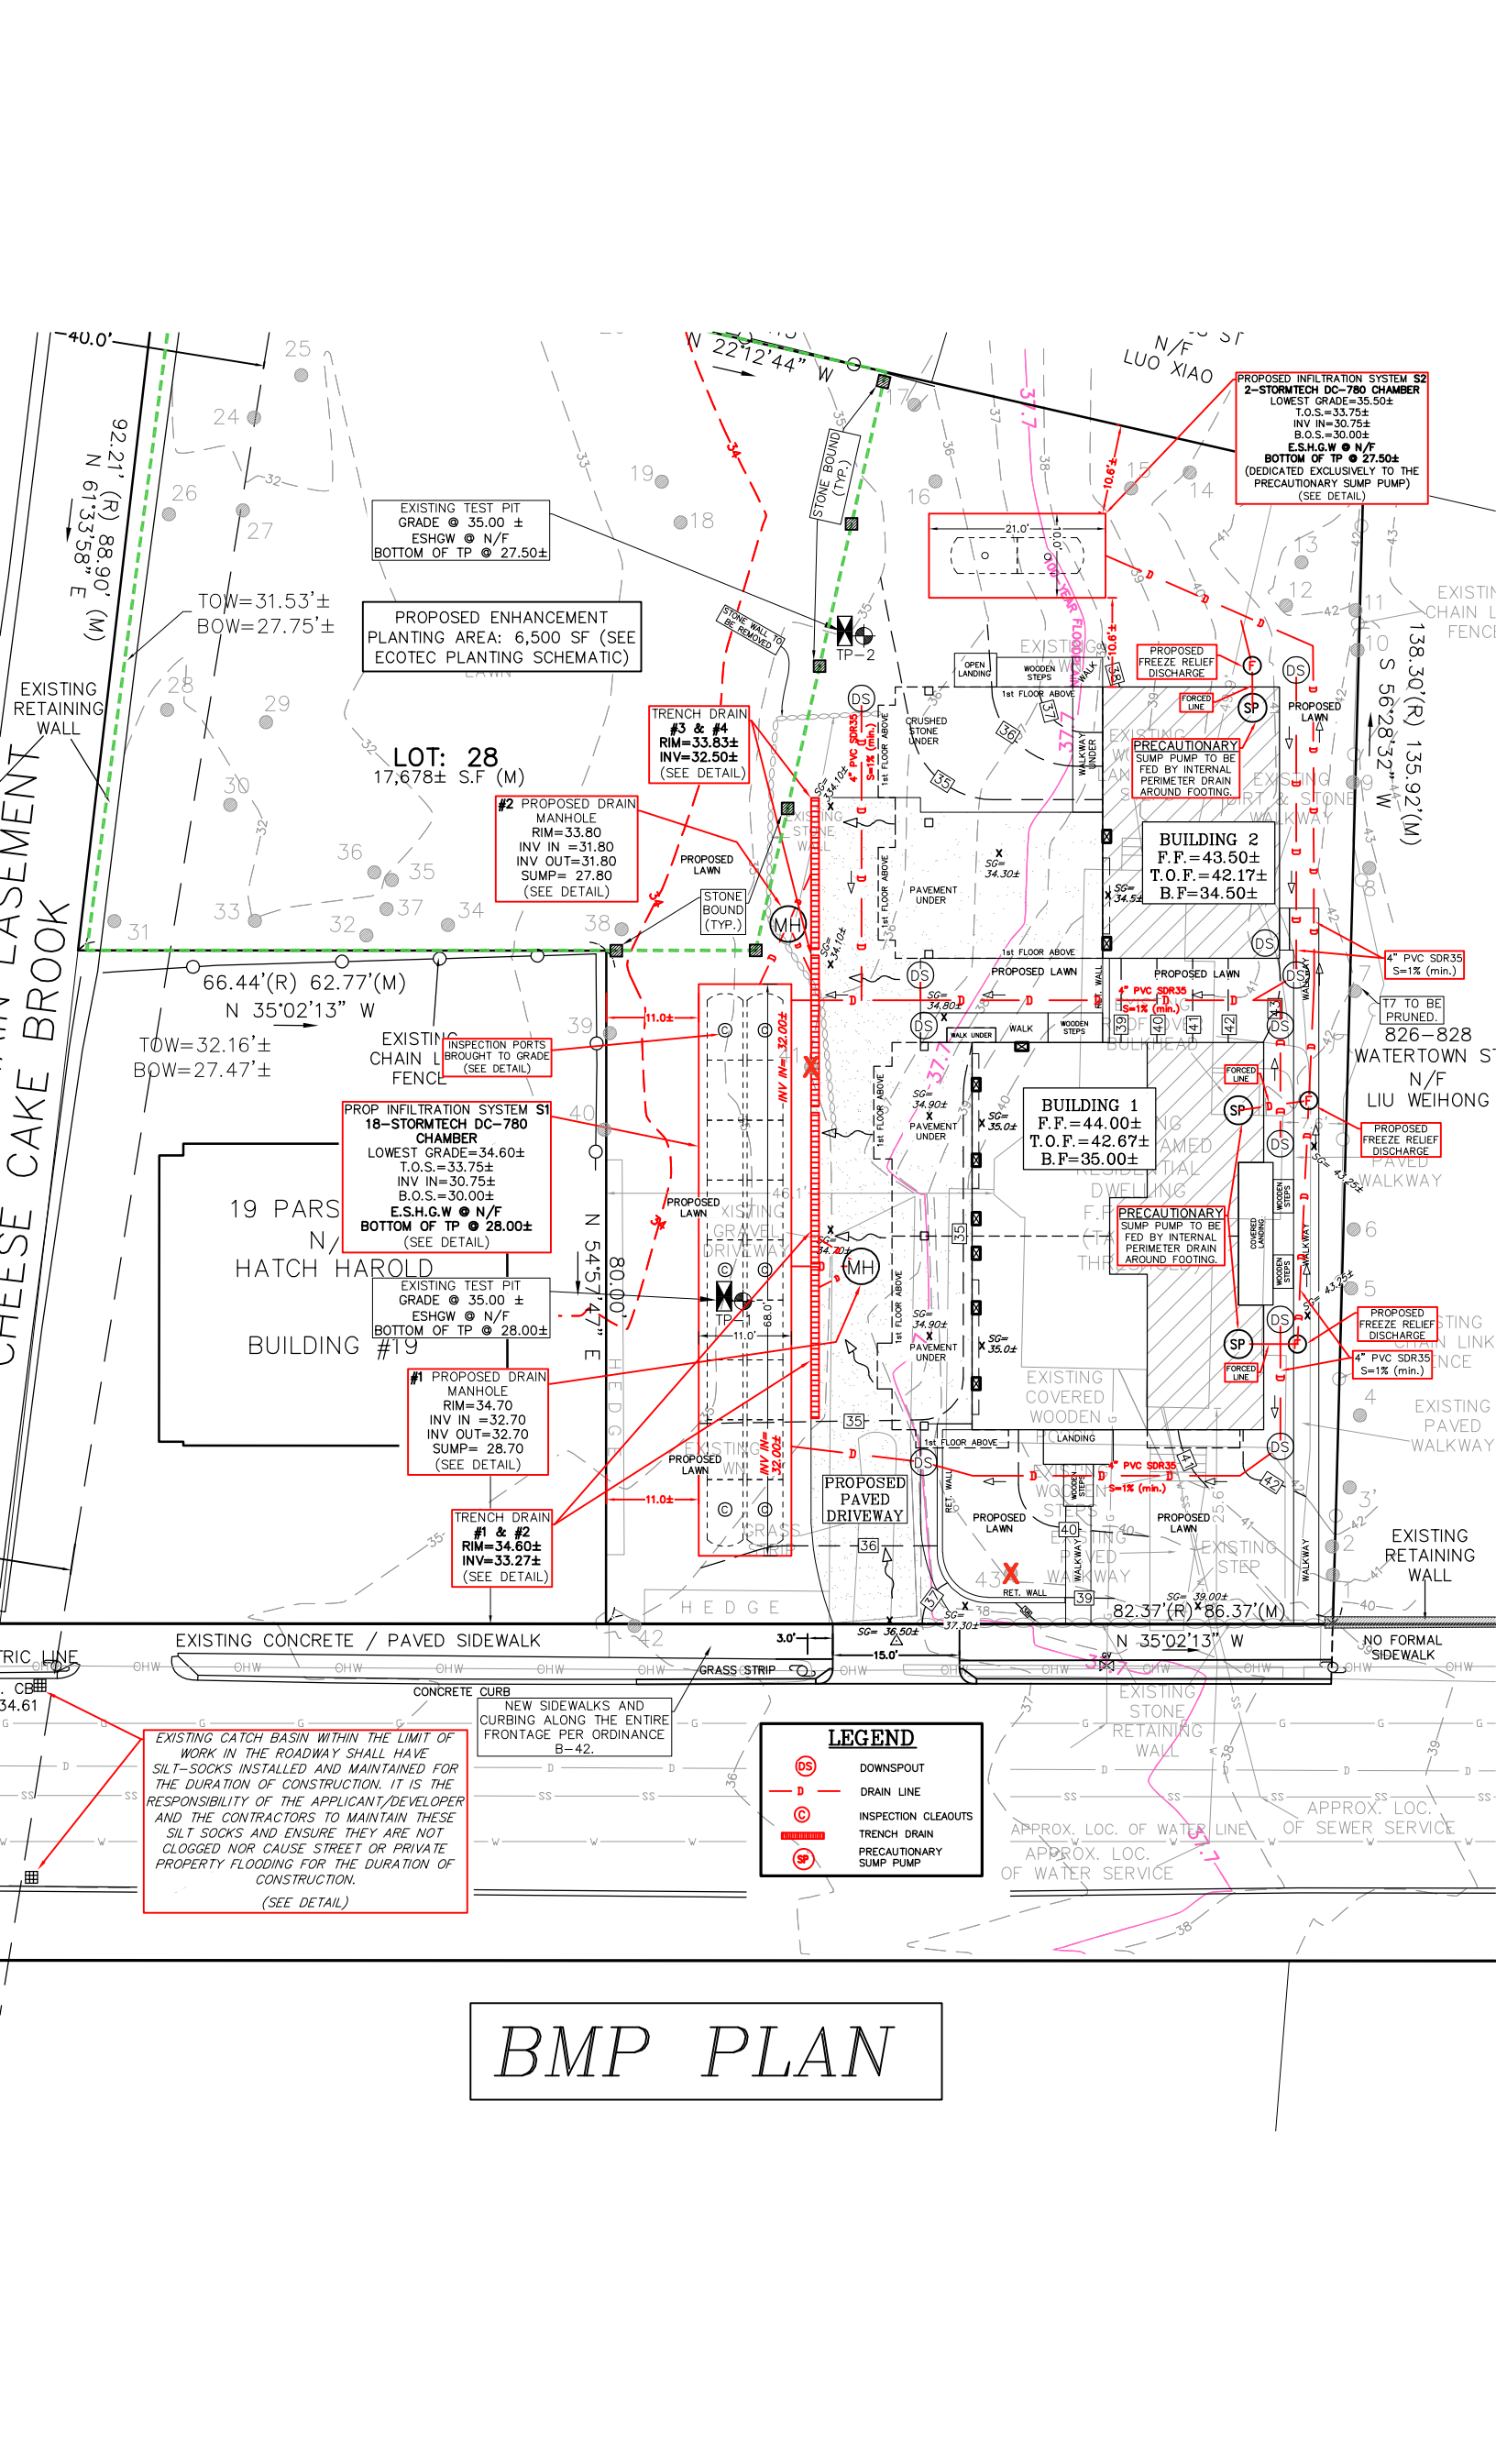

EXISTING TEST PIT
GRADE @ 35.00 ±
ESHGW @ N/F
BOTTOM OF TP @ 27.50±

PROPOSED ENHANCEMENT
PLANTING AREA: 6,500 SF (SEE
ECOTEC PLANTING SCHEMATIC)

LOT: 28
17,678± S.F. (M)

#2 PROPOSED DRAIN
MANHOLE
RIM=33.80
INV IN=31.80
INV OUT=31.80
SUMP= 27.80
(SEE DETAIL)

TRENCH DRAIN
#3 & #4
RIM=33.83±
INV=32.50±
(SEE DETAIL)

PROPOSED INFILTRATION SYSTEM S2
2-STORMTECH DC-780 CHAMBER
LOWEST GRADE=35.50±
T.O.S.=33.75±
INV IN=30.75±
B.O.S.=30.00±
E.S.H.G.W @ N/F
BOTTOM OF TP @ 27.50±
(DEDICATED EXCLUSIVELY TO THE
PRECAUTIONARY SUMP PUMP)
(SEE DETAIL)

PRECAUTIONARY
SUMP PUMP TO BE
FED BY INTERNAL
PERIMETER DRAIN
AROUND FOOTING.

BUILDING 2
F.F.=43.50±
T.O.F.=42.17±
B.F.=34.50±

PROP INFILTRATION SYSTEM S1
18-STORMTECH DC-780
CHAMBER
LOWEST GRADE=34.60±
T.O.S.=33.75±
INV IN=30.75±
B.O.S.=30.00±
E.S.H.G.W @ N/F
BOTTOM OF TP @ 28.00±
(SEE DETAIL)

EXISTING TEST PIT
GRADE @ 35.00 ±
ESHGW @ N/F
BOTTOM OF TP @ 28.00±

#1 PROPOSED DRAIN
MANHOLE
RIM=34.70
INV IN=32.70
INV OUT=32.70
SUMP= 28.70
(SEE DETAIL)

TRENCH DRAIN
#1 & #2
RIM=34.60±
INV=33.27±
(SEE DETAIL)

BUILDING 1
F.F.=44.00±
T.O.F.=42.67±
B.F.=35.00±

PRECAUTIONARY
SUMP PUMP TO BE
FED BY INTERNAL
PERIMETER DRAIN
AROUND FOOTING.

PROPOSED
FREEZE RELIEF
DISCHARGE

4" PVC SDR35
S=1% (min.)

EXISTING CATCH BASIN WITHIN THE LIMIT OF
WORK IN THE ROADWAY SHALL HAVE
SILT-SOCKS INSTALLED AND MAINTAINED FOR
THE DURATION OF CONSTRUCTION. IT IS THE
RESPONSIBILITY OF THE APPLICANT/DEVELOPER
AND THE CONTRACTORS TO MAINTAIN THESE
SILT SOCKS AND ENSURE THEY ARE NOT
CLOGGED NOR CAUSE STREET OR PRIVATE
PROPERTY FLOODING FOR THE DURATION OF
CONSTRUCTION.
(SEE DETAIL)

NEW SIDEWALKS AND
CURBING ALONG THE ENTIRE
FRONTAGE PER ORDINANCE
B-42.

LEGEND	
	DOWNSPOUT
	DRAIN LINE
	INSPECTION CLEAOUTS
	TRENCH DRAIN
	PRECAUTIONARY SUMP PUMP

BMP PLAN